

# ABSENCE OF WATER DETECTOR



## 2808 Series

- ◆ Senses The Lack Of Or Presence Of Any Non-Volatile Liquid
  - ◆ Microprocessor Controlled
  - ◆ Submersible and Fully Self Contained
  - ◆ 12" Cable



2808

The G.R.I. 2808 Absence of Water Detector is targeted for monitoring a fluid level height. This submersible sensor can safely and reliably sense and respond to the absence of or presence of a non-volatile liquid in a wide range of environmental conditions.

The G.R.I. 2808 Series of Water Detectors are microprocessor controlled devices that produce an AC Signal between two stainless steel probes. Depending on the conductivity measured between the two probes, a set of internal relay contacts will be latched in an open or closed position.

Sensor life span is optimized by periodically sampling for liquid at set timed intervals. Conductivity sampling between the two probes once every 2.5 minutes are used in the Standard Self Powered 2808 allowing for a 4-year expectancy. A sampling rate of once every 30 seconds is used with the Externally Powered 2808-12V providing a 15+ year life expectancy. Instantaneous triggering and custom sampling rates are also available on request.

External connections are made through the included 12 inches of Direct Burial cable allowing for up to a foot of total submersion, burial or harsh environmental exposure. Custom cable length are also available on request.

<b>2808</b>	<b>Self Powered/2.5 minute sample rate/C form relay output</b>
<b>2808-12V</b>	<b>External 12VDC/30 Second Sample Rate/C form relay output</b>

### Warranty:


One year warranty against workmanship, material and factory defects.

GEORGE RISK INDUSTRIES, INC.  
G.R.I. PLAZA  
KIMBALL, NE 69145



MADE IN U.S.A.

TOLL-FREE 1-800-445-5218  
TOLL-FREE 1-800-523-1227  
(308) 235-4645  
FAX (308) 235-3561  
E-MAIL: [grisales@megavision.com](mailto:grisales@megavision.com)  
WEB SITE: [www.grisk.com](http://www.grisk.com)

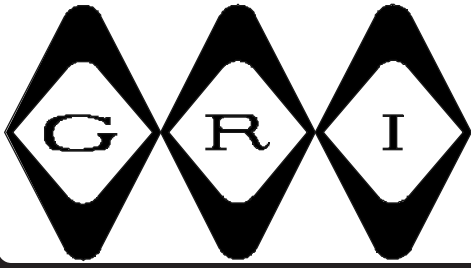



# ABSENCE OF WATER DETECTOR

## INSTALLING THE G.R.I. 2808:

The G.R.I. Absence of Water Detector is installed by mounting the unit so that sensor probes are located at the desired fluid level position. Insertion of the 2808 into the liquid will confirm that mounting point as the **minimum** liquid level height. Mounting the 2808 above and out of the liquid will confirm that mounting point as the **maximum**

liquid level height. The latching C form relay output will set upon first initial sampling after mounting, and maintain that set during subsequent samplings up to and until a change in status occurs. At that time, the C form relay will reset, signalling that change. The device is secured in place using the provided plastic strap. Connections to the relay contact wires are made using a suitable wire connector. Note: Watertight connectors may be needed if connector location will be submerged.

These detectors should be inspected and tested annually. If there is damage the detector should be replaced.

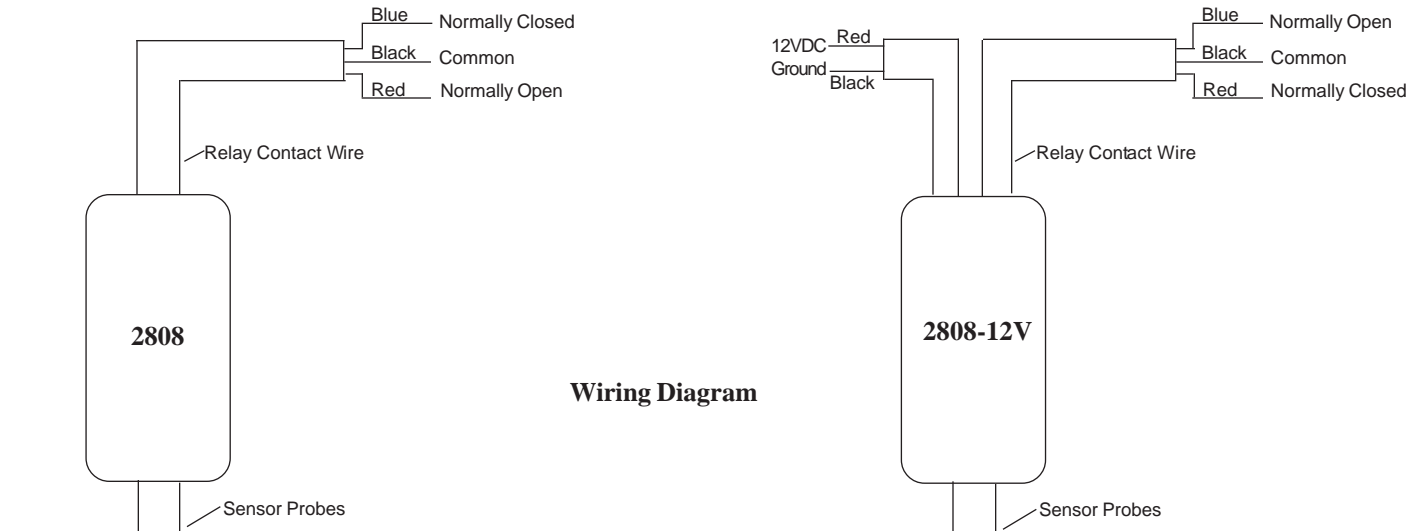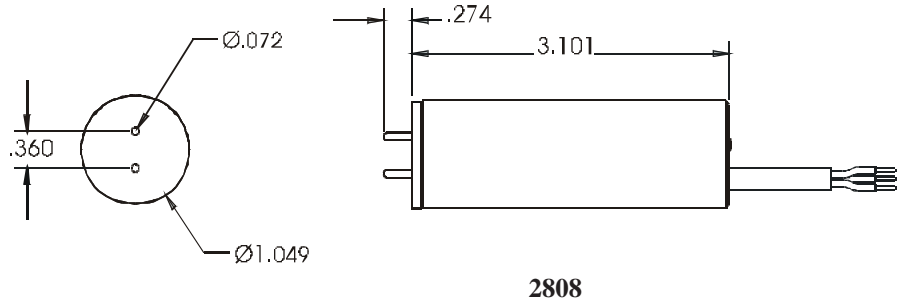

### SPECIFICATIONS:

#### 2808-12V Only

Operating Voltage	12 volts DC
Operating Current	7 mA nominal
<b>2808 and 2808-12V</b>	
Operating Temperature:	70° C to -40° C
<b>Contact Rating:</b>	
Nominal Switching Capacity:	2A @ 30VDC
Maximum Switching Power:	60W
Maximum Switching Voltage:	220VDC
Maximum Switching Current:	2A

GEORGE RISK INDUSTRIES, INC.  
G.R.I. PLAZA  
KIMBALL, NE 69145



MADE IN U.S.A.

TOLL-FREE 1-800-445-5218  
TOLL-FREE 1-800-523-1227  
(308) 235-4645 • FAX (308) 235-3561  
E-MAIL: [grisales@megavision.com](mailto:grisales@megavision.com)  
WEB SITE: [www.grisk.com](http://www.grisk.com)